



SINGLE VOLTAGE – THREE PHASE WITH OVERLOAD PROTECTOR



NOTE:
ACTUAL PROTECTORS
TERMINAL LOCATIONS
FOR LEAD CONNECTIONS

NOTE:
WEST PLAINS

LEADS WITH TERMINALS
SHOULD BE CONNECTED
TO INBOARD SIDE OF
TERMINAL BOARD.

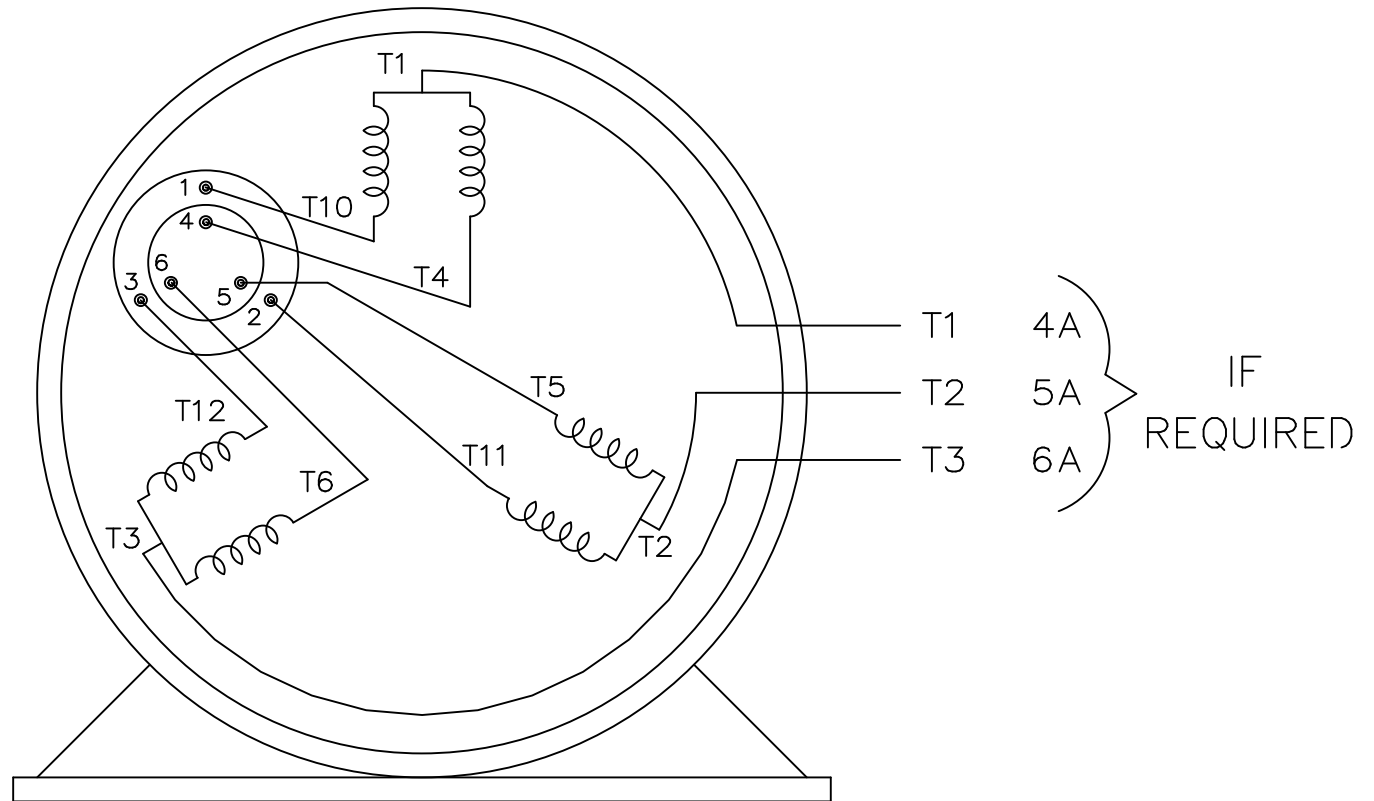

VIEW OF TERMINAL END

TO REVERSE ROTATION:
INTERCHANGE ANY TWO LINE
LEAD CONNECTIONS.

NO.	REVISION	BY & DATE	CHK	TOLERANCES UNLESS SPECIFIED		MARATHON ELECTRIC	DRAWN DA 03-26-1993			
				DEC.	INCHES			CHK ML 03-26-1993		
8	ADDED 4A, 5A & 6A "IF REQUIRED" MU80422	RJW 07-10-2007	ML	.X	± -	TITLE CONNECTION DIAGRAM SINGLE VOLT - 3Ø W/OVERLOAD PROT.	APPD GK 03-26-1993			
7	ADDED TERM. BOARD CONNECTION NOTE CN 19219	SMC 10-13-1994		.XX	± -		SCALE 1=1			
6	ADDED ACTUAL PROTECTOR VIEW CN 17481	KL 05-18-1994		.XXX	± -	MAT'L.	REF			
5	REDRAWN - NO CHANGE	DA 03-29-1993		.XXXX	± -		FINISH	FMF		
				ANG	± -		PREV			
THIS DRAWING IN DESIGN AND DETAIL IS OUR PROPERTY AND MUST NOT BE USED EXCEPT IN CONNECTION WITH OUR WORK ALL RIGHTS OF DESIGN AND INVENTION ARE RESERVED THIS IS AN ELECTRONICALLY GENERATED DOCUMENT - DO NOT SCALE THIS PRINT				RFP	CAD FILE ee7335a		SIZE A	DRAWING NO. EE7335A	PAGE OF 8	REV. 8
				DIST LB-WP						